


BS EN ISO 1716: 2018

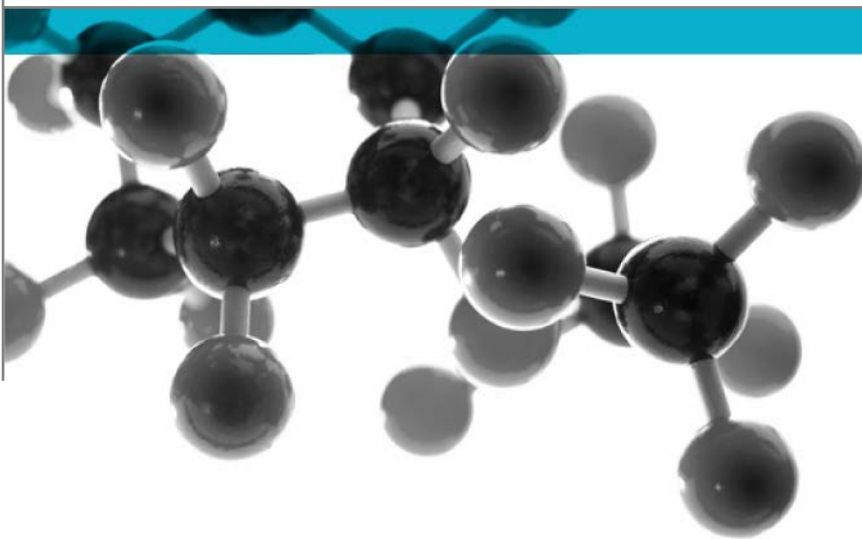

Determination Of The Heat Of Combustion For Building Products

A Report To: Wallbarn Ltd.

Document Reference: 435938

Date: 23rd February 2021

Issue No.: 1

Page 1



0249

Executive Summary

Objective To determine the performance of the following material when tested in accordance with BS EN ISO 1716: 2018.


Generic Description	Product reference	Thickness	Weight per unit area
Epoxy -polyester coating	"INTERPON 700"	60micron	149g/m ²
Please see page 5 of this test report for the full description of the product tested			


Test Sponsor Wallbarn Ltd., Unit 16, Capital Business Centre, 22 Carlton Road, South Croydon, CR2 0BS

Test Results: **Gross Calorific Value** = **20.2923MJ/kg**
Gross Calorific Value per Unit Area at 0.149kg/m² = **3.0236MJ/m²**

Date of Test 15th & 16th December 2020

Signatories


Responsible Officer H Harper* Testing Officer


Authorised C Jacques * Senior Technical Officer

* For and on behalf of [Warringtonfire](#).

Report Issued: 23rd February 2021

This version of the report has been produced from a .pdf format electronic file that has been provided by [Warringtonfire](#) to the sponsor of the report and must only be reproduced in full. Extracts or abridgements of reports must not be published without permission of [Warringtonfire](#).

Document No.: 435938
Author: H Harper
Client: Wallbarn Ltd.

Page No.: 2 of 8
Issue Date: 23rd February 2021
Issue No.: 1



CONTENTS	PAGE NO.
EXECUTIVE SUMMARY	2
SIGNATORIES.....	2
TEST DETAILS.....	4
DESCRIPTION OF TEST SPECIMENS.....	5
TEST RESULTS	6
TABLE 1	7
REVISION HISTORY	8

Test Details

Purpose of test

To determine the calorific potential of a building material during combustion when it is tested in accordance with the test specified in BS EN ISO 1716:2018 “Reaction To Fire Tests For Building Products – Determination Of The Heat Of Combustion”.

The test was performed in accordance with the procedure specified in BS EN ISO 1716:2018 and this test report should be read in conjunction with that European Standard.

Scope of test

BS EN ISO 1716 specifies a method of test for determining the heat of combustion of building materials at constant volume in a bomb calorimeter. Results are reported as individual values which may be interpreted by reference to other documents; e.g. EN 13501-1:2018 “Fire Classification of Construction Products and Building Elements Part 1 Classification using Test Data from Reaction to Fire Tests.

The test is intended for materials or products whether composite products or coated products. The results reported here relate to one individual component of a composite product and can be used in combination with other results to provide the classification in accordance with BS EN 13501, within a classification report.

Fire test study group/EGOLF

Certain aspects of some fire test specifications are open to different interpretations. The Fire Test Study Group and EGOLF have identified a number of such areas and have agreed Resolutions which define common agreement of interpretations between fire test laboratories which are members of the Groups. Where such Resolutions are applicable to this test they have been followed.

Instruction to test

The test was conducted on the 15th & 16th December 2020 at the request of Wallbarn Ltd., the sponsor of the test.

Provision of test specimens

The specimens were supplied by the sponsor of the test. Warringtonfire was not involved in any selection or sampling procedure. The results stated in this report apply to the samples as received.

Conditioning of specimens

The specimens were received on the 17th November 2020. Prior to test the prepared specimens were conditioned for at least 48 hours at a temperature of $23 \pm 2^{\circ}\text{C}$ and a relative humidity of $50 \pm 5\%$, in accordance with BS EN 13238:2010.

Test procedure

The specimens were tested using an additional combustible substance of known and high calorific value which for this test was paraffin oil. The specimens were tested using the crucible method in an isoperibol bomb calorimeter.

The water equivalent (E) of the bomb calorimeter was 0.01010 MJ/K.

Description of Test Specimens

The description of the system given below has been prepared from information provided by the sponsor of the test. This information has not been independently verified by Warringtonfire. All values quoted are nominal, unless tolerances are given.

Generic type	Epoxy -polyester coating
Product reference	"INTERPON 700"
Name of manufacturer	AkzoNobel
Colour	"Grey"
Application thickness	60microns
Application rate	149g/m ²
Application method	Manual and automatic pistols
Flame retardant details	See Note 1 below
Curing process	15 minutes at 180°C

Note 1: The sponsor was unable to provide this information.

Specimen preparation

The specimens were homogeneous and were prepared by selecting portions of the material from the sample submitted for test to give a total mass of 50g. These were then ground and reduced to a fine powder prior to conditioning for test.

Test Results

Results of test

The results are detailed in Table 1.

The test results relate only to the specimens of the product in the form in which they were tested. Small differences in the composition of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product which is supplied or used is fully represented by the specimens which were tested.

The test results relate to the behaviour of the test specimen of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use.

For the product tested, the following results relating to the gross calorific potential were obtained.

Gross Calorific Value per Unit Mass	20.2923	MJ/kg
Gross Calorific Value per Unit Area at 0.149kg/m²	3.0236	MJ/m²

Validity

The specification and interpretation of fire test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over five years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of [Warringtonfire](#).

Table 1

Bomb Calorimeter Calculations

The specimen, "INTERPON 700", is homogeneous

End use thickness of specimen:- 60micron

Gross Calorific Potential Per Unit Mass

<u>Test 1:-</u>	sample weight =	0.2159	g			
	calorific value =	20.4302	MJ/kg	=	20430.2	kJ/kg
	temperature rise =	2.0201	°C			
<u>Test 2:-</u>	sample weight =	0.1611	g			
	calorific value =	20.0135	MJ/kg	=	20013.5	kJ/kg
	temperature rise =	1.7370	°C			
<u>Test 3:-</u>	sample weight =	0.1592	g			
	calorific value =	20.4333	MJ/kg	=	20433.3	kJ/kg
	temperature rise =	1.7289	°C			
				Average =	20292.3	kJ/kg
					<u>20.2923</u>	<u>MJ/kg</u>

Revision History

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	

